



中国国家强制性产品认证证书

证书编号: 2024010305637074

认证委托人名称及地址

浙江力夫自控技术股份有限公司
浙江省乐清市乐清经济开发区 纬十五路 220 号

生产者名称及地址

浙江力夫自控技术股份有限公司
浙江省乐清市乐清经济开发区 纬十五路 220 号

生产企业名称及地址

浙江力夫自控技术股份有限公司
浙江省乐清市乐清经济开发区 纬十五路 220 号

产品名称和系列、型号、规格

压力开关

LF25: Ui:400V;Uimp:2.5kV;LF25-X1: AC-15: Ie/ Ue: 16A/125V AC, 16A/250V AC; Ith: 16A; LF25-X2: AC-15: Ie/ Ue: 21A/125V AC, 21A/250V AC; Ith: 21A; LF25-X3: AC-15: Ie/ Ue: 5A/125V AC, 5A/250V AC; Ith: 5A; LF25-X4: AC-15: Ie/ Ue: 15A/125V AC, 15A/250V AC; Ith: 15A; LF25-X5: AC-15: Ie/ Ue: 22A/125V AC, 22A/250V AC; Ith: 22A; 型号解释见附页

产品标准和技术要求

GB/T 14048.5-2017

上述产品符合《强制性产品认证实施规则 低压电器 低压元器件》
(CNCA-C03-02:2024) 的要求, 特发此证。

发证日期: 2024 年 06 月 03 日 有效期至: 2029 年 06 月 02 日

证书信息和有效性可扫描下方二维码或登录发证机构网站查验,
也可在认监委网站 (www.cnca.gov.cn) 查询。



签发:

谢肇煦



中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE

中国质量认证中心有限公司






中国国家强制性产品认证证书

证书编号：2024010305637074

证书附页：第 1 页 共 1 页

型号解释：

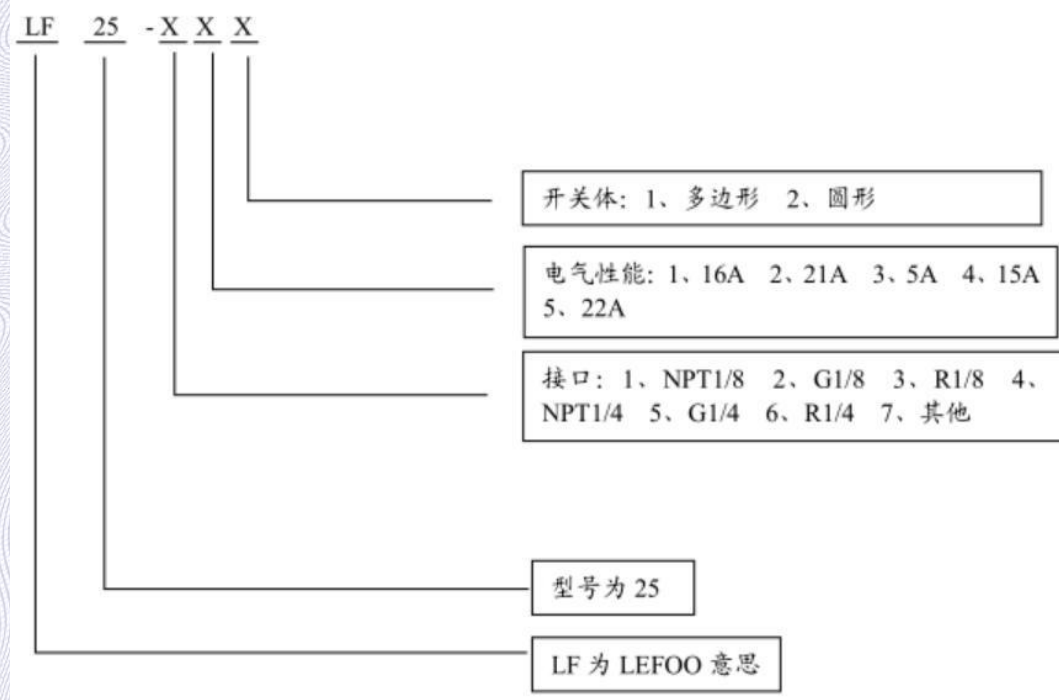

本页为证书附页，应与证书主页同时使用。



中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE

中国质量认证中心有限公司



CERTIFICATE FOR CHINA COMPULSORY PRODUCT CERTIFICATION

本翻译文件不具有法律效力，
不得单独使用
This translated document
does not have legal validity and
cannot be used in isolation

CERTIFICATE NO.: 2024010305637074

NAME AND ADDRESS OF THE APPLICANT

ZHEJIANG LEFOO CONTROLS CO., LTD.

No.220 Weishiwu Road, Yueqing Economic Development Zone, Yueqing City, Zhejiang Province,
P.R.China

NAME AND ADDRESS OF THE MANUFACTURER

ZHEJIANG LEFOO CONTROLS CO., LTD.

No.220 Weishiwu Road, Yueqing Economic Development Zone, Yueqing City, Zhejiang Province,
P.R.China

NAME AND LOCATION OF THE FACTORY

ZHEJIANG LEFOO CONTROLS CO., LTD.

No.220 Weishiwu Road, Yueqing Economic Development Zone, Yueqing City, Zhejiang Province,
P.R.China

PRODUCT NAME,MODEL AND SPECIFICATION

Pressure Switch

LF25 : Ui:400V;Uimp:2.5kV;LF25-X1 : AC-15: Ie/ Ue: 16A/125V AC,16A/250V AC;Ith: 16A;LF25-X2 : AC-15: Ie/
Ue:21A/125V AC, 21A/250V AC;Ith: 21A;LF25-X3 :AC-15: Ie/ Ue: 5A/125V AC, 5A/250V AC;Ith: 5A;LF25-X4 :AC-15:
Ie/ Ue: 15A/125V AC, 15A/250V AC;Ith: 15A;LF25-X5 : AC-15: Ie/ Ue: 22A/125V AC, 22A/250V AC;Ith: 22A ; See the
appendix

STANDARDS AND TECHNICAL REQUIREMENTS FOR THE PRODUCTS

GB/T 14048.5-2017

This is to certify that the above mentioned product(s) complies with the requirements of
implementation rules for compulsory certification(REFNO. CNCA-C03-02:2024).

Valid from: Jun.03,2024

Valid until: Jun.02,2029

The certificate information and validity could be checked by scanning the QR code below or logging in to
the website of the issuing authority, or on the website of the CNCA (www.cnca.gov.cn).



SIGNATURE:

谢肇煦



中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE

CHINA QUALITY CERTIFICATION CENTRE CO., LTD.






CERTIFICATE FOR CHINA COMPULSORY PRODUCT CERTIFICATION

CERTIFICATE NO. : 2024010305637074

Appendix: Page 1 of 1

本翻译文件不具有法律效力，
不得单独使用
This translated document
does not have legal validity and
cannot be used in isolation

型号解释:

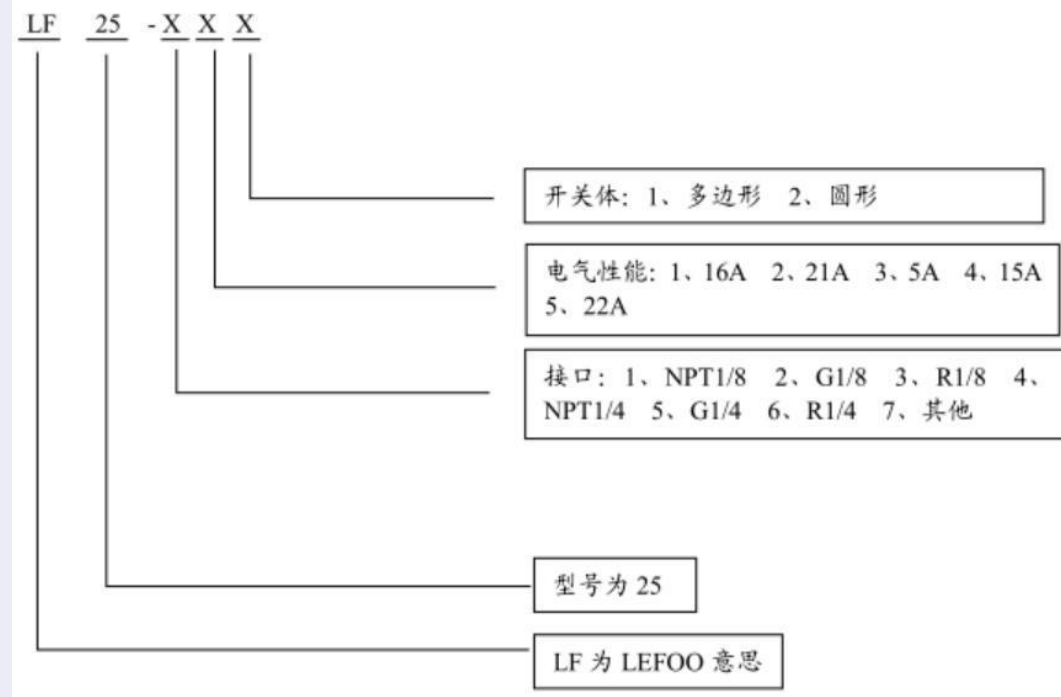

This page is attached to the certificate and should be used at the same time as the certificate page.



中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE

CHINA QUALITY CERTIFICATION CENTRE CO., LTD.